


GENERAL NOTES

1. Ramps for handicapped shall be constructed at pedestrian crosswalk.
2. Drainage design in the vicinity of ramps for handicapped shall be considered an integral part of the design of these ramps. No drainage structure shall be placed within the limits of a ramp for handicapped on new designs.
3. Ramps for handicapped shall be constructed the same as sidewalks, except that the texture of the concrete shall be a course broom finish transverse to the slope of the ramp.
4. Care shall be taken to assure a uniform grade on the ramp, free of abrupt changes.
5. Minimum width of ramps for handicapped shall be 3'-4".
6. Existing concrete sidewalk shall be cut with concrete saw for installation of ramps for handicapped.
7. Ramp Layout shall be such that Expansion Joints shall not form acute angles.

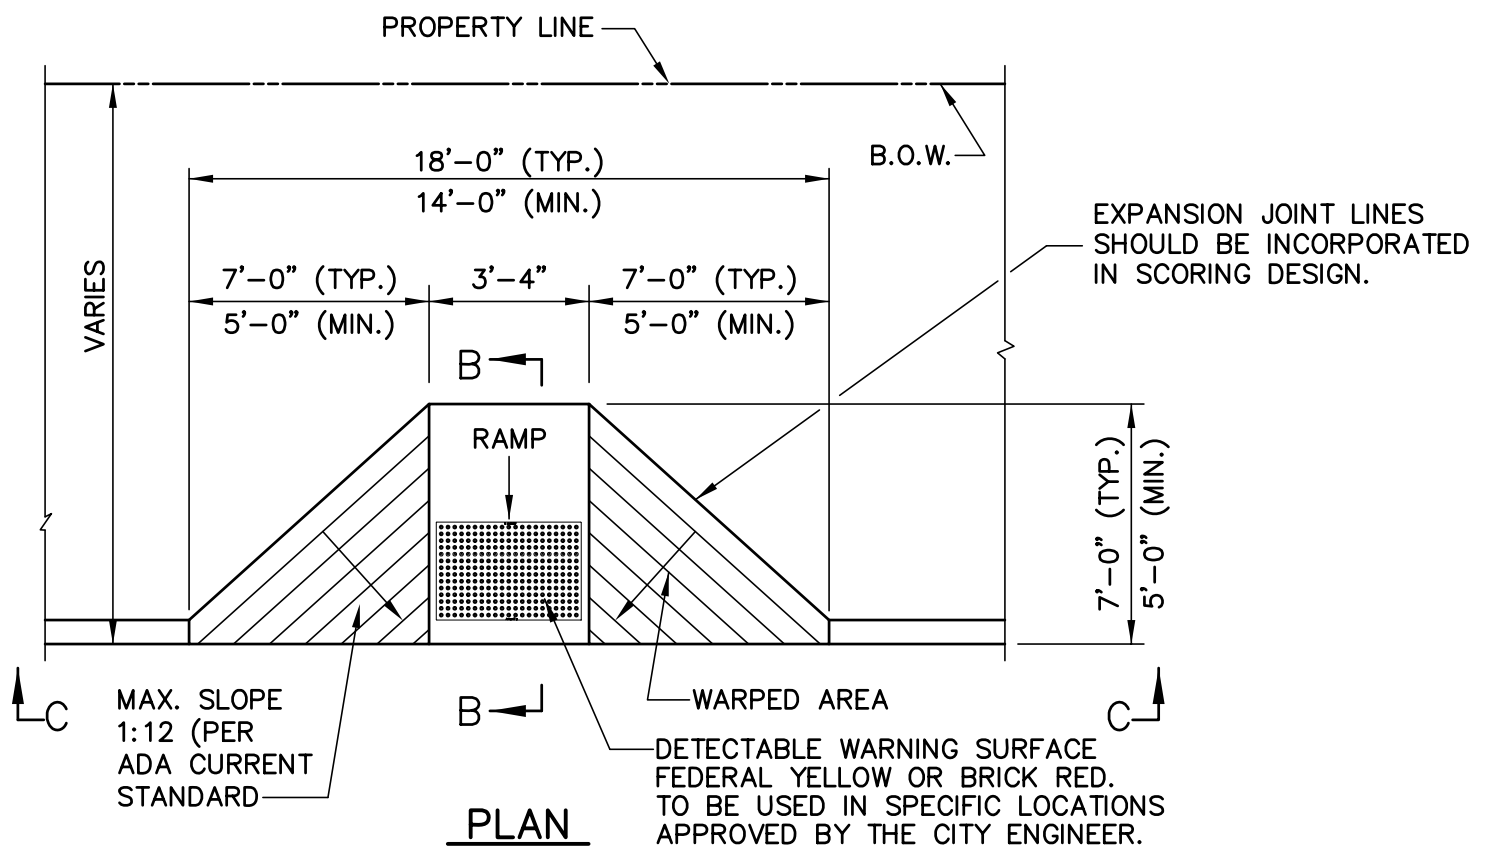

RAMP FOR HANDICAPPED – TYPICAL SECTION

SCALE: 1/4" = 1'-0"